


POTATO STORAGE
 80,000 CWT
 2-6-74 D.R. LUNDSTROM
 PAGE 2 OF 2


EXTENSION AGRICULTURAL ENGINEERING DEPT.
 NORTH DAKOTA STATE UNIVERSITY
 FARGO, NORTH DAKOTA

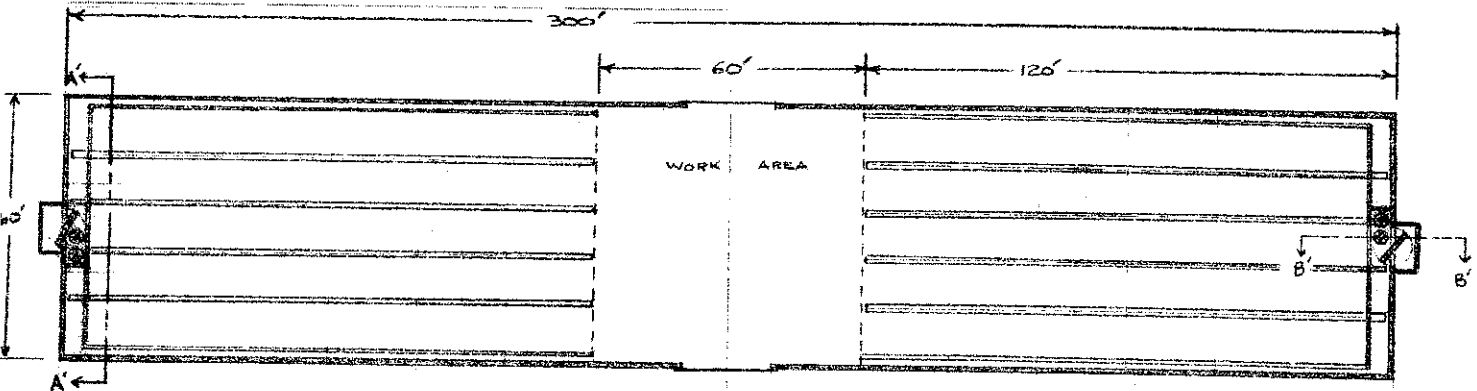

VENTILATION

- 2 FANS AT EACH END, 20,000 CFM EACH @ 3/4" SP APPROX. 42" DIA., 5 HP FANS
- 4 TRENCHES FROM EACH END
- 24" WIDE x 40" DEEP FIRST 60', 24" WIDE x 20" DEEP SECOND 60'
- INLET-EXHAUST HOOD AND DAMPER AS SHOWN FIGURE 7, CIRCULAR AE-90, "POTATO VENTILATION" DAMPER 4'x8'

SCALE 1" = 20'

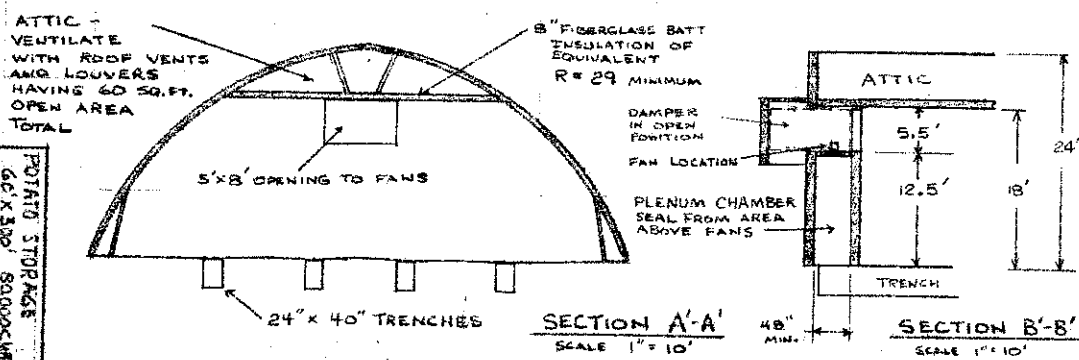

POTATO STORAGE
 80,000 CWT
 SCALE AS SHOWN
 2-6-74 D.R. LUNDSTROM
 PAGE 1 OF 2

EXTENSION AGRICULTURAL ENGINEERING DEPT.
 NORTH DAKOTA STATE UNIVERSITY
 FARGO, NORTH DAKOTA

ND 726-6-9
 POTATO STORAGE
 60' x 300' 80000 CWT